TYPICAL FIRE HYDRANT INSTALLATION

Notes:

1. Keep drain holes unclogged and free of debris.
2. Hydrants shall be manufactured by the Mueller Co. 250 series or City approved equal. (5.25" barrel, (2) 2.5" connectors and (1) 4.5" connector)
3. Restrainers, as required, to be anchor couplings for fire hydrant and Mega Lug for all connections or City of Greenville approved equal.
4. Paint Silver. – Nozzle will need to be painted as directed by the City.
5. Steamer nozzle facing the roadway.

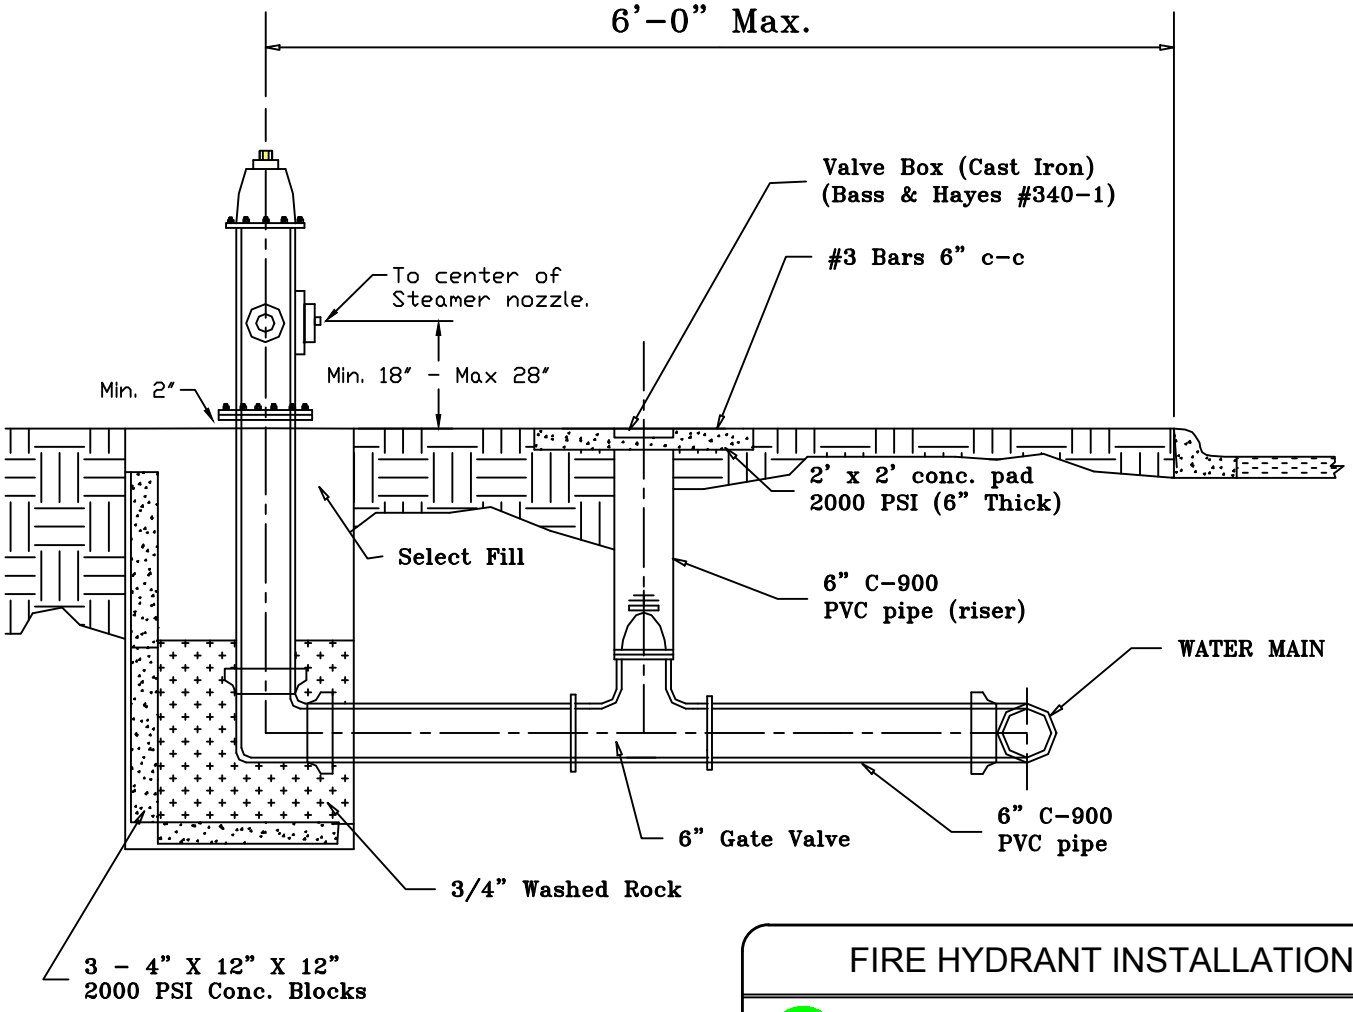

FIRE HYDRANT INSTALLATION

CITY OF GREENVILLE
PUBLIC WORKS DEPARTMENT

DRAWN: K. Colbert	SCALE: NTS	
DATE DRAWN: 2-14-01	DATE REVISED: 4-25-16	DRAWING NO. 26004