


Fence Elevation


Section A - A
Column Detail

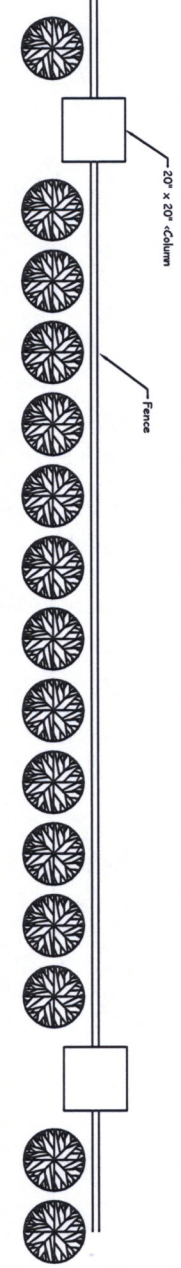

1. Concrete minimum compressive strength: 3000 PSI @ 28 Days (Class 'A').
2. Provide expansion joints @ 90 feet centers maximum.
3. Walls shall not be placed in the Visibility Easement of Street Right-of-Way.
4. The City shall be responsible for approving the aesthetic characteristics of the wall, including color, pattern, texture and or plant material at the time of approval of the development.
5. Maximum plaster spacing 10'.
6. Mortar shall be Type 'S', 1800 PSI, A.S.T.M. 270.
7. No portion of a screening wall shall be used as a retaining wall.
8. Contractor to verify location of all existing utilities prior to construction.
9. Block type, color and specification information shall be furnished to the City for approval.
10. Wall shall be a minimum of 6' high above the street or as determined by the City if the street is not improved.

NO SCREENING WALL OR FENCE SHALL BE ERECTED THAT WILL OBSTRUCT THE VISION OF MOTORISTS AT AN ALLEY, STREET OR DRIVE INTERSECTION.

When piers are in dry a 30" Bell Footing shall be used for additional bearing.



Bell Footing

WROUGHT IRON SCREENING WALL	
DRAWN: K. Cobert DATE DRAWN: 9/24/07	SCALE: NTS DATE REVISION:
DRAWING NO. 29002	